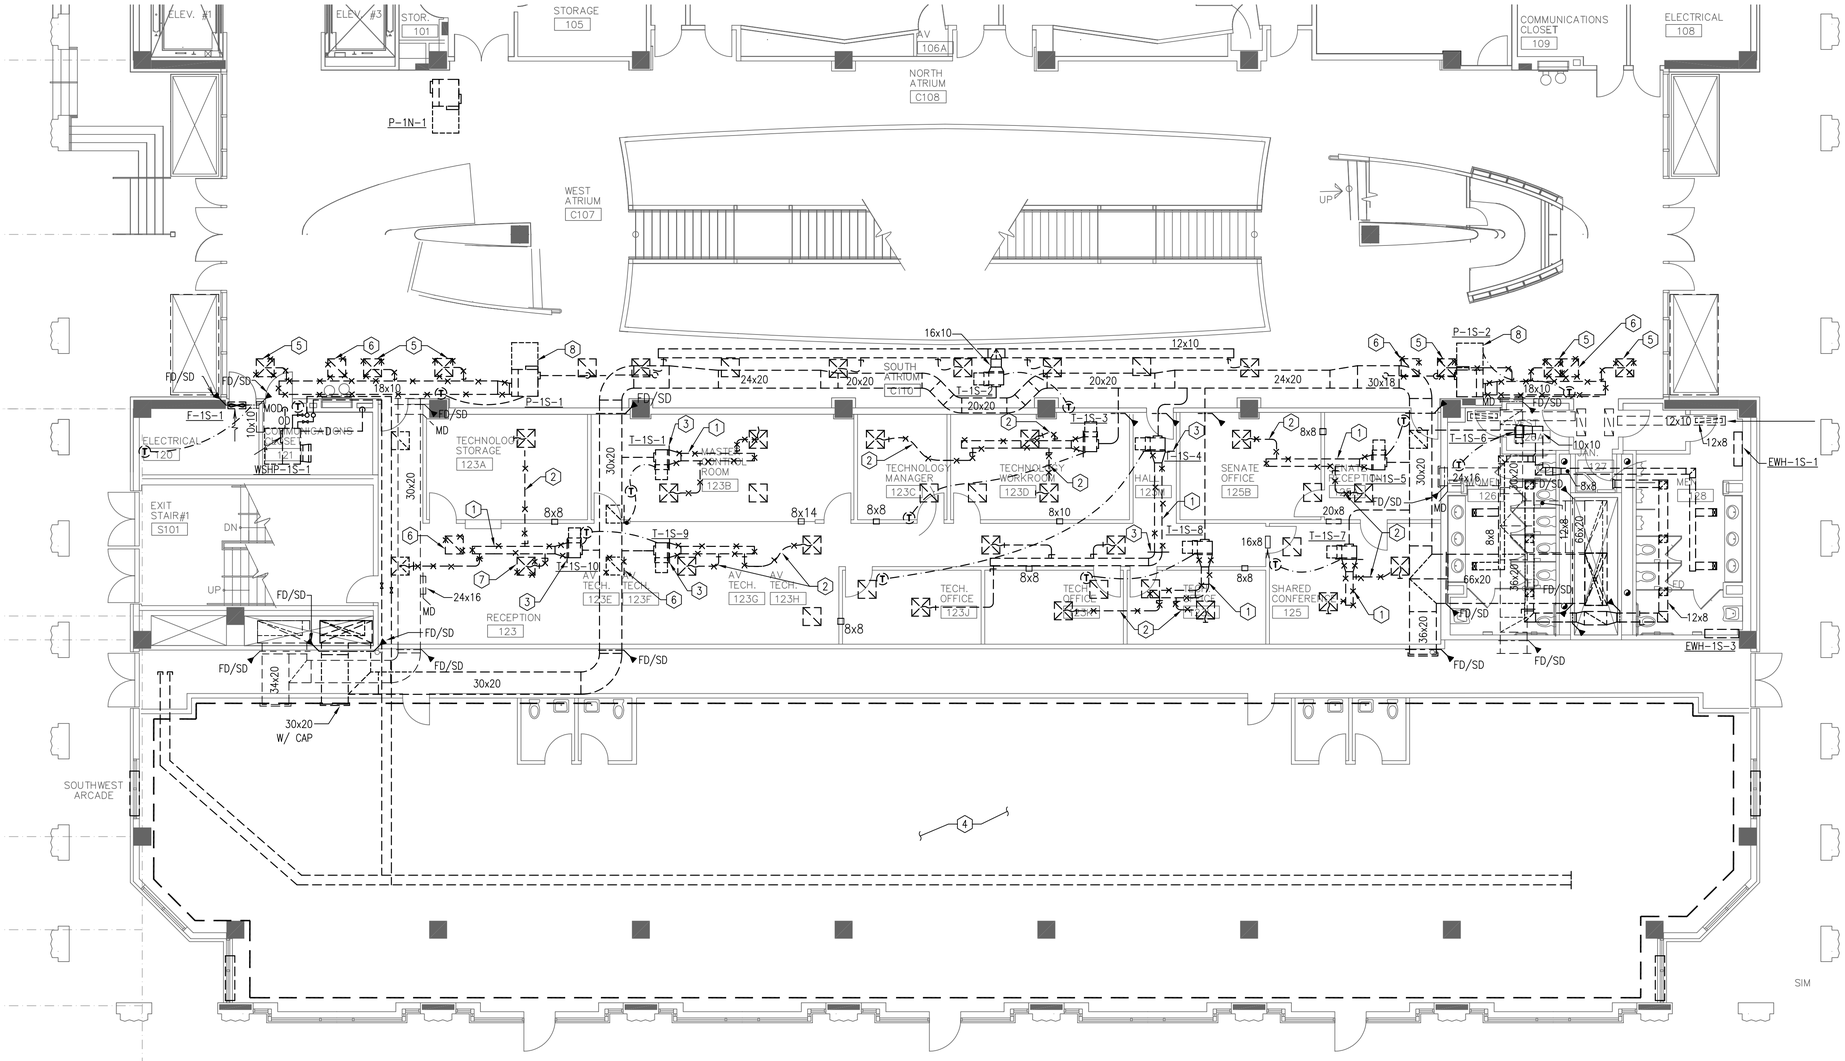

N

1 / M111B **GROUND FLOOR LEVEL SOUTH - HVAC DEMOLITION PLAN**

SCALE: 1/8" = 1'-0"

KEY NOTES

1. REMOVE SECTION OF S.A. DUCTWORK. THE LENGTH OF DUCTWORK REMOVED SHALL BE AT LEAST THE MINIMUM REQUIRED TO ACCOMMODATE THE INSTALLATION OF THE STRAIGHT LENGTH OF NEW DUCTWORK AS SHOWN ON DRAWING M211B.
2. REMOVE THE RUN-OUT DUCT, INCLUDING FLEX DUCT, AND SPIN-IN FITTING.
3. LIMIT OF DEMOLITION WORK, TYPICAL.
4. EXISTING BUILD-OUT OF TENANT SPACE NOT SHOWN.
5. REMOVE THE EXISTING S.A. DIFFUSERS AND ASSOCIATED RUN-OUT DUCTS. PATCH ANY UN-REUSED OPENING IN THE S.A. DUCT.
6. REMOVE THE LAY-IN TYPE R.A. GRILLE. STORE, CLEAN AND REINSTALL THE G RILLE AS SHOWN ON DRAWING M211B.
7. REMOVE, STORE, REUSE AND REINSTALL THE EXISTING DIFFUSER AS SHOWN ON DRAWING M211B.
8. REMOVE THE POWERED INDUCTION UNIT (PIU). REPLACEMENT PIU SHOWN ON DRAWING M211B. REFER TO DETAIL 4/M401.

Georgia State University

GEORGIA REGISTERED PROFESSIONAL ENGINEER TIMOTHY L. NORTH

Georgia State University

Improve Aderhold Learning Center HVAC Systems

NO.	REVISIONS	DATE

GROUND FLOOR LEVEL SOUTH - HVAC DEMOLITION PLAN

JSA JOB NUMBER	09JS15
DRAWN BY	RPG
CHECKED BY	--
DATE	JULY 31, 2009

DRAWING NUMBER

M111B

5 OF 20 SHEETS

CONSULTING ENGINEERS

Johnson, Spellman & Associates, Inc.

6991 Peachtree Industrial Boulevard, Building 700,
Norcross, Georgia 30092
Phone (770) 447-4555 Fax (770)246-9042
visit us at www.jsace.com

© 2007 Johnson, Spellman & Associates, Inc.